


Series 70 eSTS

1600A, 2-source, 3-pole, 3-wire, 65kA, SMR

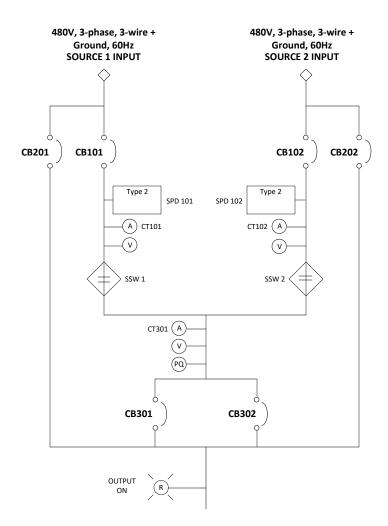





NOTE:


REFER TO THE MECHANICAL OUTLINE DRAWING FOR INFORMATION ON THE CUSTOMER CONNECTION TERMINALS.

	- T - 7	DAGE DESCRIPTION
PQ	POWER QUALITY METERING POINT	
v	VOLTAGE METERING POINT	
A	CURRENT METERING POINT	
LEGEN	D	


LAYERZERO POWER SYSTEMS, INC.			PAGE DESCRIPTION ONE LINE DIAGRAM, eSTS	
JOB	DRAWN	DATE 8/9/2023	DWG NO	REV
LZ-11061	СНК	DATE	94-ES-11061-1	Α
	APPR	DATE	SHEET 1 OF 2	

CUSTOMER INTERFACE BOARD (CIB)

EXTERNAL CONTROL CONTACTS

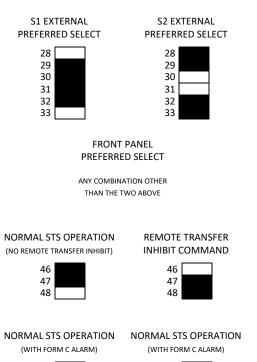

SYMBOL FOR CLOSED CONTACTS J2

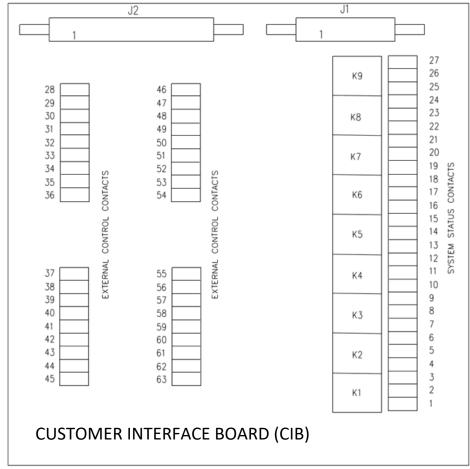

SYSTEM STATUS CONTACTS

NORMAL STS OPERATION REMOTE TRANSFER INHIBIT (NO REMOTE TRANSFER INHIBIT) COMMAND RECEIVED 24 23 23

SOURCE 2 FAILURE SOURCE 2 AVAILABLE

SOURCE 1 FAILURE SOURCE 1 AVAILABLE

SOURCE 1 SOURCE 2 ACTIVE SOURCE ACTIVE SOURCE

SUMMARY ALARM

NO SUMMARY ALARM

NOTES:

- 1. TERMINAL NUMBERS REFER TO TERMINALS ON CUSTOMER INTERFACE BOARD (CIB), REFER TO THE MECHANICAL OUTLINE DRAWING FOR EXACT LOCATION OF THE CIB AND CUSTOMER WAN.
- 2. TERMINALS SUITABLE FOR AWG 20-16 STRANDED COPPER WIRE. MAXIMUM ONE WAY LENGTH FOR #16: 500 ft (152 m).
- 3. ALL WIRING TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE AND ALL LOCAL CODES. CONTROL AND STATUS WIRING MUST BE RUN AND IN SEPARATE CONDUIT FROM POWER WIRING.

- 5. SYSTEM CONTROL INPUTS READ COMMANDS FROM EXTERNAL CONTACTS. CUSTOMER REQUIREMENTS ARE AS FOLLOWS:
 - a. Dry, potential-free contacts.
 - b. Form C
 - c. Contacts are to be capable of switching 24 V DC at 5 mA < I < 10 mA.

LayerZero			PAGE DESCRIPTION	
POWER SYSTEMS, INC.		ONE LINE DIAGRAM, eSTS		
JOB	DRAWN	DATE 8/9/2023	DWG NO	REV
LZ-11061	СНК	DATE	94-ES-11061-1	Α
	APPR	DATE	SHEET 2 OF 2	

4. SYSTEM STATUS OUTPUTS ARE DRY, POTENTIAL-FREE
CONTACTS. CUSTOMER REQUIREMENTS ARE AS FOLLOWS:
a. Circuit voltage V < 250 V AC with current I < 12 A RMS, power factor = 1.0.
b. Circuit voltage V < 200 V DC with current I < 0.4 A.