


Series 70 eRDP

CIRCUIT BREAKER DATA

REF NO	RATING	FAULT RATING	TYPE	MOUNTING	AUXILIARY CONTACTS	SHUNT TRIPS	MFG	BREAKER SERIES
CB701	600AF / 600AT, 100%	65kAIC @ 480VAC (per UL ratings)	Electronic Trip (LSI) w/ Measuring 2	Fixed	No	No	ABB	Tmax XT5

230/400V, 3-Phase, 4-Wire + Ground, 60Hz
600A, 100% Neutral

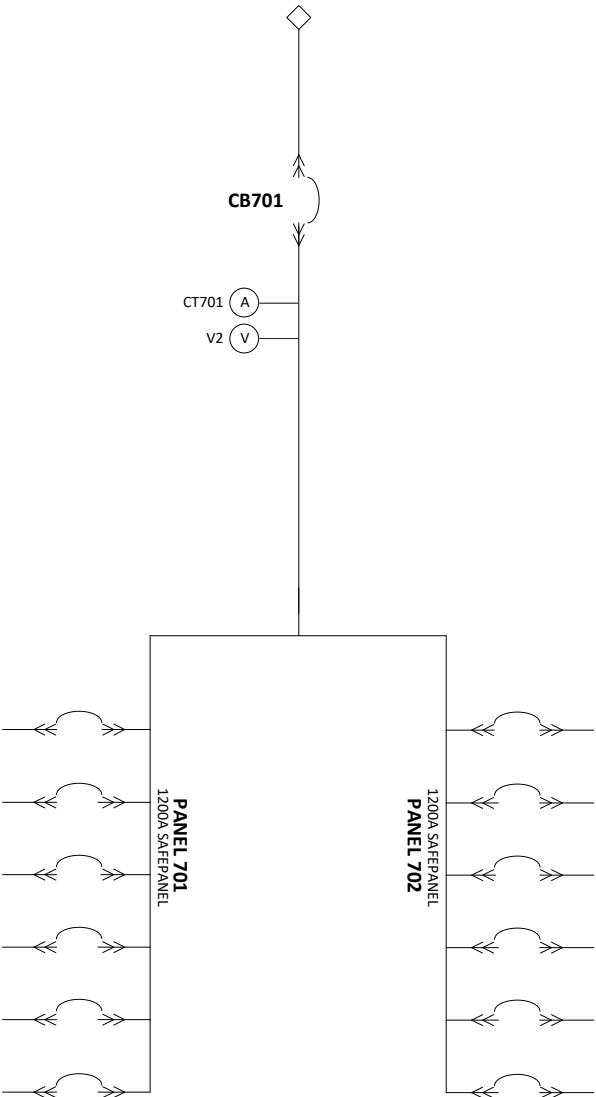

CB701

CT701


V2

PANEL 701
1200A SAFEPANEL

PANEL 702
1200A SAFEPANEL

ADDITIONAL INFORMATION:
1. Input Terminals: Two-hole Compression Lug Terminals
2. Display Type: Incorporated into Main Circuit Breaker

SAFEPANEL NOTES
1. SAFEPANEL IS CENTER-TAPPED.
2. MAXIMUM TOTAL CURRENT: 1200A
3. MAXIMUM CURRENT ON EITHER SIDE OF TAP: 800A
4. FOR 400AF SUBFEED CIRCUIT BREAKERS:
a. MAXIMUM RATING OF ADJACENT CIRCUIT BREAKERS: 80%
b. FOR 100% RATING, ONE EMPTY SPACE IS REQUIRED ABOVE CIRCUIT BREAKER.

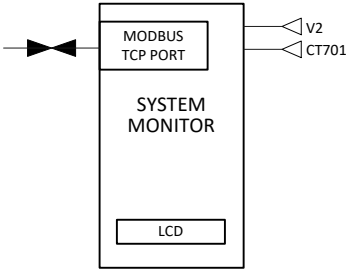

LEGEND				
(A)	CURRENT METERING POINT	(PQ)	POWER QUALITY METERING POINT	
(V)	VOLTAGE METERING POINT			
			PAGE DESCRIPTION	
			ONE LINE DIAGRAM, RDP	
JOB	DRAWN	DATE	DWG NO	REV
LZ-11212	CHK	DATE	94-ES-11212-1	A
	APPR	DATE	SHEET 1 OF 1	