
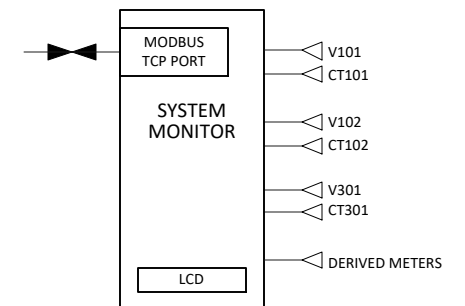


CIRCUIT BREAKER DATA

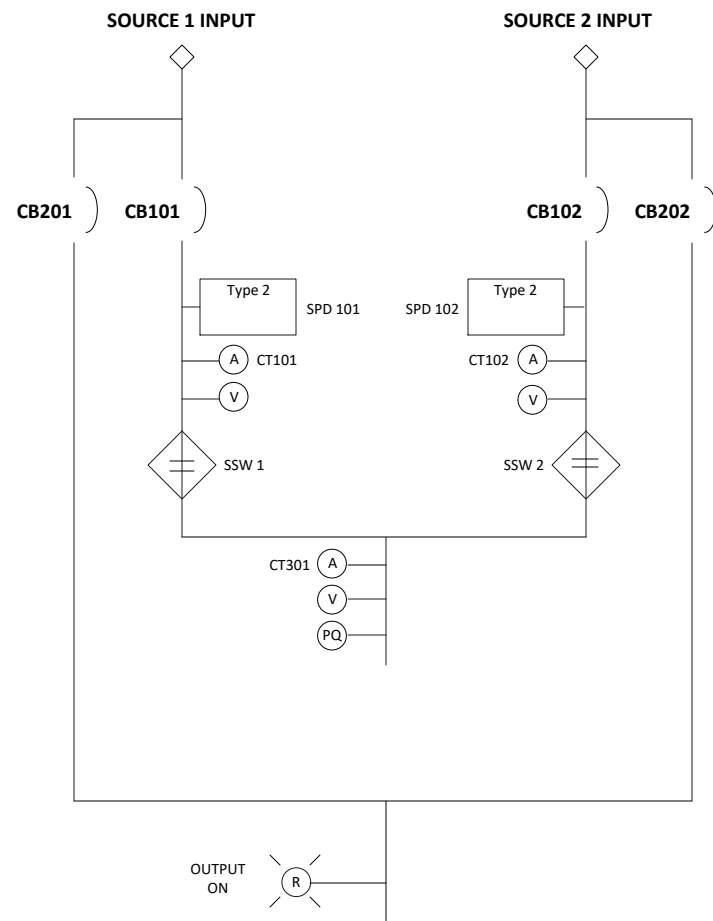

NOTE:

REFER TO THE MECHANICAL OUTLINE DRAWING FOR INFORMATION ON THE CUSTOMER CONNECTION TERMINALS.

LEGEND

- (A) CURRENT METERING POINT
- (V) VOLTAGE METERING POINT
- (PQ) POWER QUALITY METERING POINT




PAGE DESCRIPTION  
ONE LINE DIAGRAM, eSTS

JOB	DRAWN	DATE	DWG NO	REV A
	CHK	DATE		
	APPR	DATE	SHEET 1 OF 2	


# CUSTOMER INTERFACE BOARD (CIB)

## EXTERNAL CONTROL CONTACTS

S1 EXTERNAL  
PREFERRED SELECT



S2 EXTERNAL  
PREFERRED SELECT



FRONT PANEL  
PREFERRED SELECT

ANY COMBINATION OTHER  
THAN THE TWO ABOVE

NORMAL STS OPERATION  
(NO REMOTE TRANSFER INHIBIT)



REMOTE TRANSFER  
INHIBIT COMMAND




NORMAL STS OPERATION  
(WITH FORM C ALARM)



NORMAL STS OPERATION  
(WITH FORM C ALARM)



SYMBOL FOR CLOSED CONTACTS

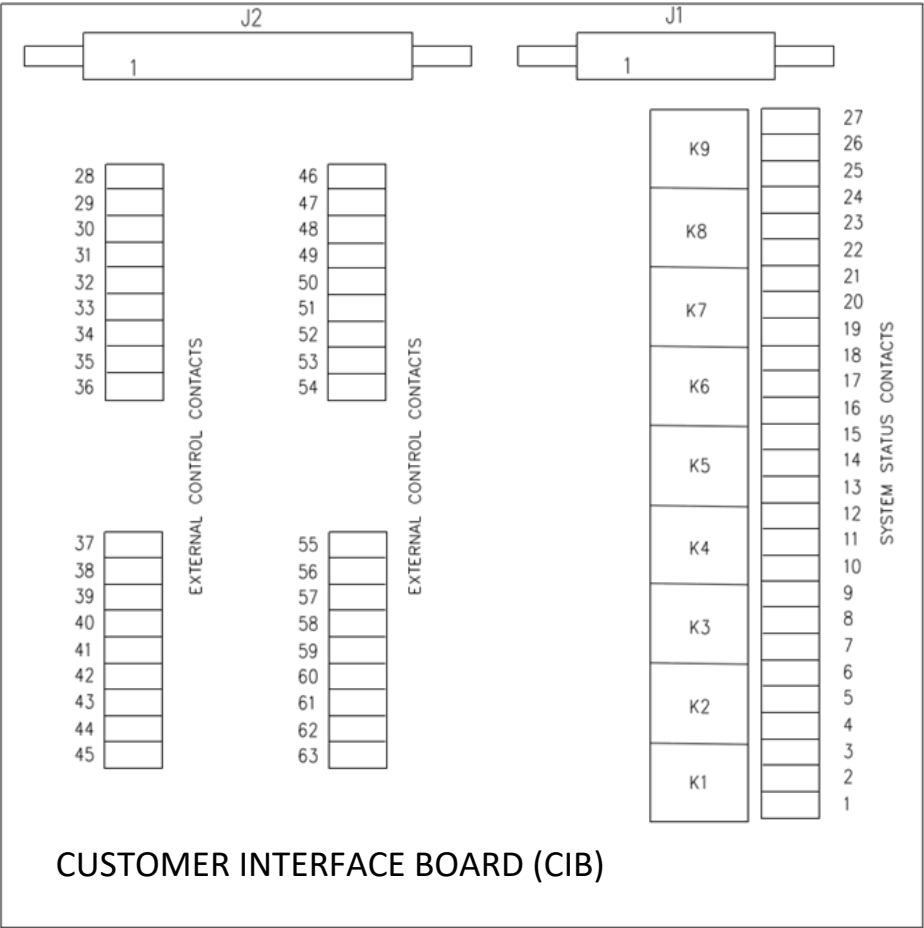

## SYSTEM STATUS CONTACTS

NORMAL STS OPERATION  
(NO REMOTE TRANSFER INHIBIT)



REMOTE TRANSFER INHIBIT  
COMMAND RECEIVED



SOURCE 2 FAILURE



SOURCE 2 AVAILABLE




SOURCE 1 FAILURE




SOURCE 1 AVAILABLE



SOURCE 1  
ACTIVE SOURCE



SOURCE 2  
ACTIVE SOURCE



SUMMARY ALARM



NO SUMMARY ALARM



## CUSTOMER INTERFACE BOARD (CIB)

### NOTES:

1. TERMINAL NUMBERS REFER TO TERMINALS ON CUSTOMER INTERFACE BOARD (CIB). REFER TO THE MECHANICAL OUTLINE DRAWING FOR EXACT LOCATION OF THE CIB AND CUSTOMER WAN.

2. TERMINALS SUITABLE FOR AWG 20-16 STRANDED COPPER WIRE. MAXIMUM ONE WAY LENGTH FOR #16: 500 ft (152 m).

3. ALL WIRING TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE AND ALL LOCAL CODES. CONTROL AND STATUS WIRING MUST BE RUN AND IN SEPARATE CONDUIT FROM POWER WIRING.

4. SYSTEM STATUS OUTPUTS ARE DRY, POTENTIAL-FREE CONTACTS. CUSTOMER REQUIREMENTS ARE AS FOLLOWS:  
a. Circuit voltage  $V < 250$  V AC with current  $I < 12$  A RMS, power factor = 1.0.  
b. Circuit voltage  $V < 200$  V DC with current  $I < 0.4$  A.

5. SYSTEM CONTROL INPUTS READ COMMANDS FROM EXTERNAL CONTACTS. CUSTOMER REQUIREMENTS ARE AS FOLLOWS:  
a. Dry, potential-free contacts.  
b. Form C  
c. Contacts are to be capable of switching 24 V DC at 5 mA  $< I < 10$  mA.



**LAYERZERO**  
POWER SYSTEMS, INC.

PAGE DESCRIPTION

ONE LINE DIAGRAM, eSTS

JOB

DRAWN

DATE

CHK

DATE

APPR

DATE

DWG NO

REV

A

SHEET 2 OF 2