


## Series 70 eSTS

1200A, 2-source, 4-pole, 4-wire, 65kA, SMR

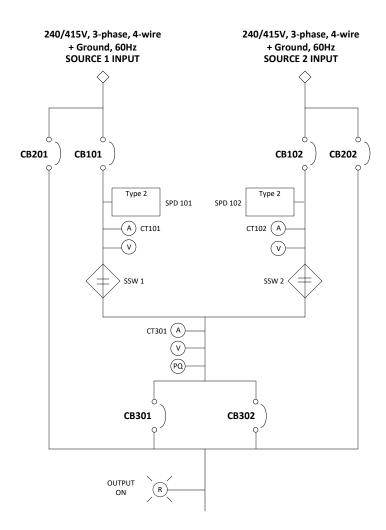



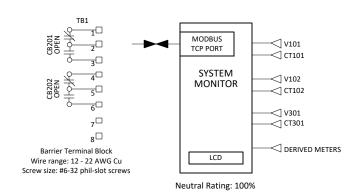

#### NOTE:


REFER TO THE MECHANICAL OUTLINE DRAWING FOR INFORMATION ON THE


CUSTOMER CONNECTION TERMINALS.				
LEGENI	)			
A	CURRENT METERING POINT			
v	VOLTAGE METERING POINT			
PQ	POWER QUALITY METERING POINT			
LayerZero LayerZero		PAGE DESCRIPTION		
(	POWER SYSTEMS, INC.	ONE LINE DIAGRAM, eSTS		


	LAYERZERO POWER SYSTEMS, INC.		ONE LINE DIAGRAM, eSTS	
JOB	DRAWN	DATE 3/31/2025	DWG NO	REV
	СНК	DATE	eSTS000810	Α
	APPR	DATE	SHEET 1 OF 2	

# CUSTOMER INTERFACE BOARD (CIB)


## **EXTERNAL CONTROL CONTACTS**

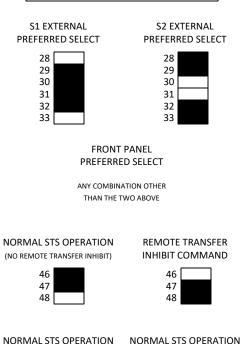



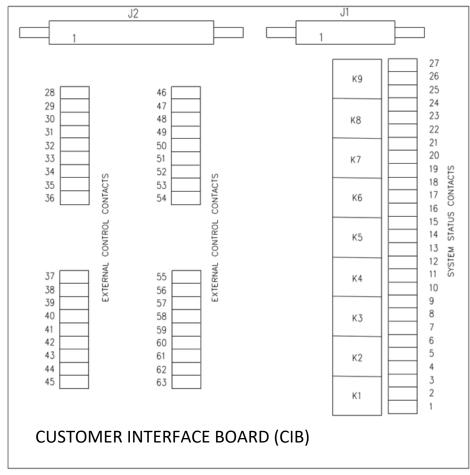

## SYSTEM STATUS CONTACTS

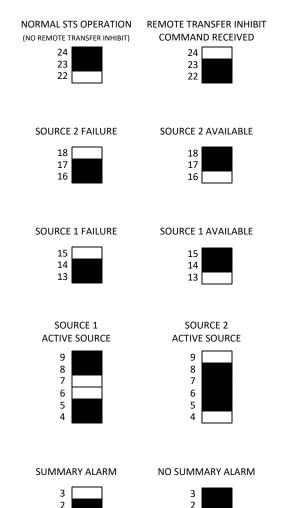

### NOTES:

(WITH FORM C ALARM)


- 1. TERMINAL NUMBERS REFER TO TERMINALS ON CUSTOMER INTERFACE BOARD (CIB). REFER TO THE MECHANICAL OUTLINE DRAWING FOR EXACT LOCATION OF THE CIB AND CUSTOMER WAN.
- 2. TERMINALS SUITABLE FOR AWG 20-16 STRANDED COPPER WIRE, MAXIMUM ONE WAY LENGTH FOR #16: 500 ft (152 m).

(WITH FORM C ALARM)

- 3. ALL WIRING TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE AND ALL LOCAL CODES. CONTROL AND STATUS WIRING MUST BE RUN AND IN SEPARATE CONDUIT FROM POWER WIRING.
- 4. SYSTEM STATUS OUTPUTS ARE DRY, POTENTIAL-FREE

CONTACTS. CUSTOMER REQUIREMENTS ARE AS FOLLOWS:

- a. Circuit voltage V < 250 V AC with current I < 12 A RMS, power factor = 1.0.
- b. Circuit voltage V < 200 V DC with current I < 0.4 A.
- b. Form C
- c. Contacts are to be capable of switching 24 V DC at 5 mA < I < 10 mA.



5. SYSTEM CONTROL INPUTS READ COMMANDS FROM EXTERNAL
CONTACTS. CUSTOMER REQUIREMENTS ARE AS FOLLOWS:
a. Dry. potential-free contacts.