
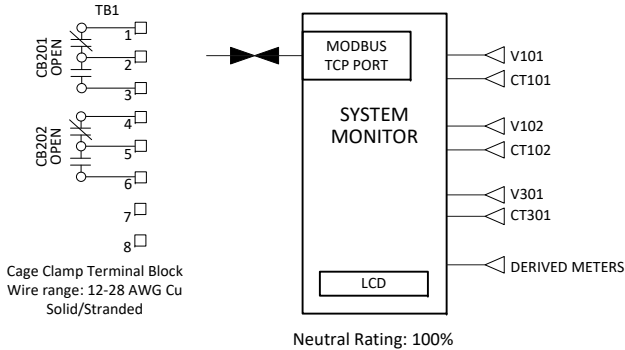


Series 70 eSTS
1200A, 2-source, 4-pole, 4-wire, 65kA, SMR

CIRCUIT BREAKER DATA

| REF NO | RATING | FAULT RATING | TYPE | MOUNTING | AUXILIARY CONTACTS | SHUNT TRIPS | MFG | BREAKER SERIES |
|----------------------------------|--------|-----------------------------------|------------------------------|----------|--------------------------|-------------|-----|----------------|
| CB101 CB201 CB102 CB202 | 1200AF | 65kA @ 480VAC (per UL ratings) | Molded Case Switch 4-pole | Fixed | Yes Internal Use Only | No | ABB | Tmax XT7 |
| CB301 CB302 | 1200AF | 65kA @ 480VAC (per UL ratings) | Molded Case Switch 4-pole | Fixed | Yes Internal Use Only | No | ABB | Tmax XT7 |

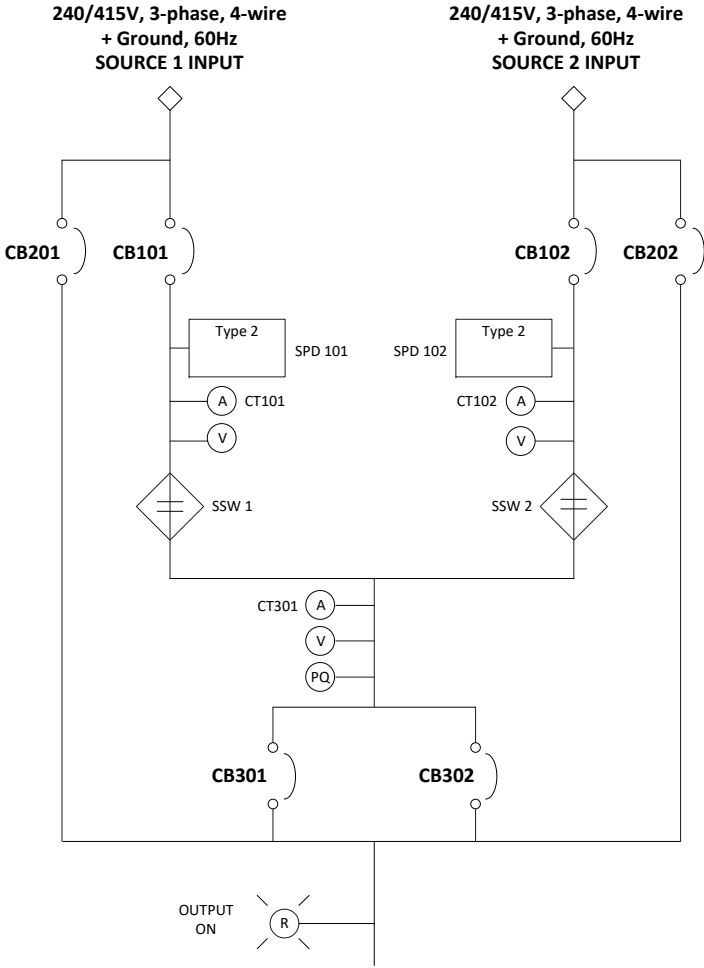

NOTE:

REFER TO THE MECHANICAL OUTLINE DRAWING FOR INFORMATION ON THE CUSTOMER CONNECTION TERMINALS.

LEGEND

- (A) CURRENT METERING POINT
- (V) VOLTAGE METERING POINT
- (PQ) POWER QUALITY METERING POINT




PAGE DESCRIPTION
ONE LINE DIAGRAM, eSTS

| | | | | |
|-----------------|----------------------|----------------------------------|-------------------------|----------|
| JOB LZ-11354 | DRAWN CHK APPR | DATE 4/4/2025 DATE DATE | DWG NO 94-ES-11354-1 | REV A |
| SHEET 1 OF 2 | | | | |


CUSTOMER INTERFACE BOARD (CIB)

EXTERNAL CONTROL CONTACTS

S1 EXTERNAL
PREFERRED SELECT



S2 EXTERNAL
PREFERRED SELECT



FRONT PANEL
PREFERRED SELECT

ANY COMBINATION OTHER
THAN THE TWO ABOVE

NORMAL STS OPERATION
(NO REMOTE TRANSFER INHIBIT)



REMOTE TRANSFER
INHIBIT COMMAND




NORMAL STS OPERATION
(WITH FORM C ALARM)



NORMAL STS OPERATION
(WITH FORM C ALARM)



SYMBOL FOR CLOSED CONTACTS

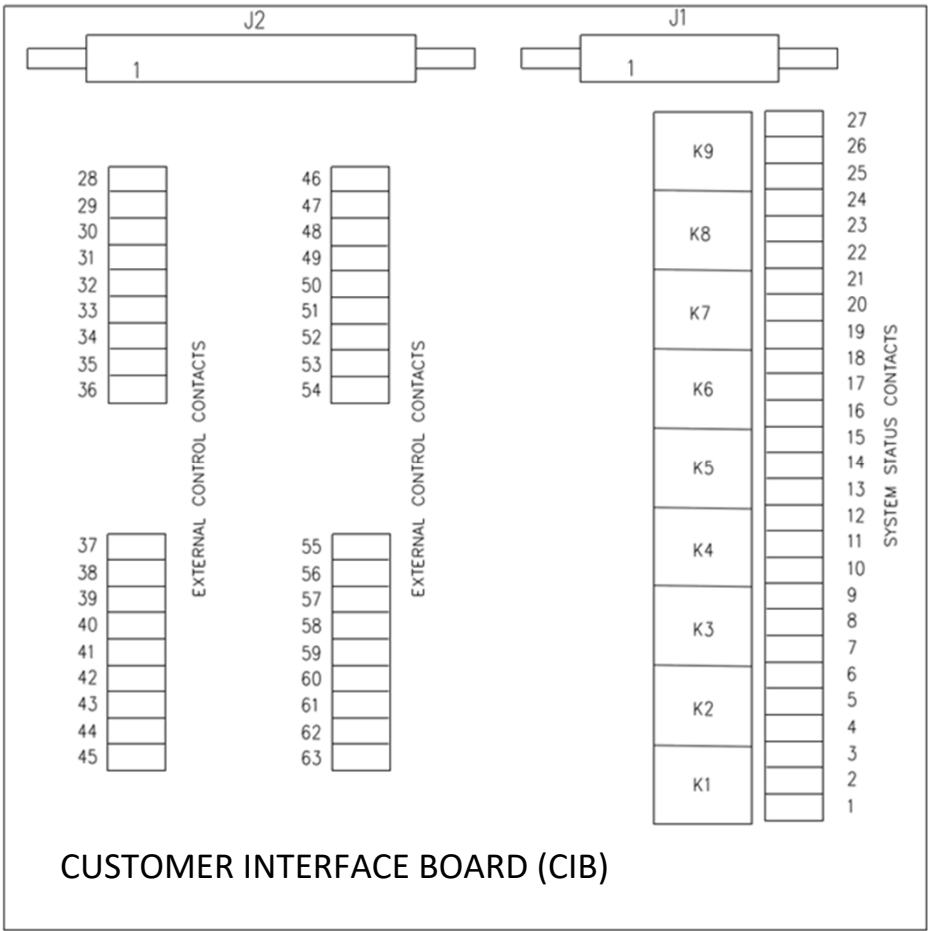

SYSTEM STATUS CONTACTS

NORMAL STS OPERATION
(NO REMOTE TRANSFER INHIBIT)



REMOTE TRANSFER INHIBIT
COMMAND RECEIVED



SOURCE 2 FAILURE



SOURCE 2 AVAILABLE




SOURCE 1 FAILURE




SOURCE 1 AVAILABLE



SOURCE 1
ACTIVE SOURCE



SOURCE 2
ACTIVE SOURCE



SUMMARY ALARM



NO SUMMARY ALARM



CUSTOMER INTERFACE BOARD (CIB)

NOTES:

1. TERMINAL NUMBERS REFER TO TERMINALS ON CUSTOMER INTERFACE BOARD (CIB). REFER TO THE MECHANICAL OUTLINE DRAWING FOR EXACT LOCATION OF THE CIB AND CUSTOMER WAN.

2. TERMINALS SUITABLE FOR AWG 20-16 STRANDED COPPER WIRE. MAXIMUM ONE WAY LENGTH FOR #16: 500 ft (152 m).

3. ALL WIRING TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE AND ALL LOCAL CODES. CONTROL AND STATUS WIRING MUST BE RUN AND IN SEPARATE CONDUIT FROM POWER WIRING.

4. SYSTEM STATUS OUTPUTS ARE DRY, POTENTIAL-FREE CONTACTS. CUSTOMER REQUIREMENTS ARE AS FOLLOWS:

- Circuit voltage $V < 250$ V AC with current $I < 12$ A RMS, power factor = 1.0.
- Circuit voltage $V < 200$ V DC with current $I < 0.4$ A.

5. SYSTEM CONTROL INPUTS READ COMMANDS FROM EXTERNAL CONTACTS. CUSTOMER REQUIREMENTS ARE AS FOLLOWS:

- Dry, potential-free contacts.
- Form C
- Contacts are to be capable of switching 24 V DC at 5 mA $< I < 10$ mA.



LAYERZERO
POWER SYSTEMS, INC.

PAGE DESCRIPTION
ONE LINE DIAGRAM, eSTS

JOB
LZ-11354

DRAWN
CHK

DATE 4/4/2025
DATE

APPR

DATE

DWG NO
94-ES-11354-1

REV
A

SHEET 2 OF 2