



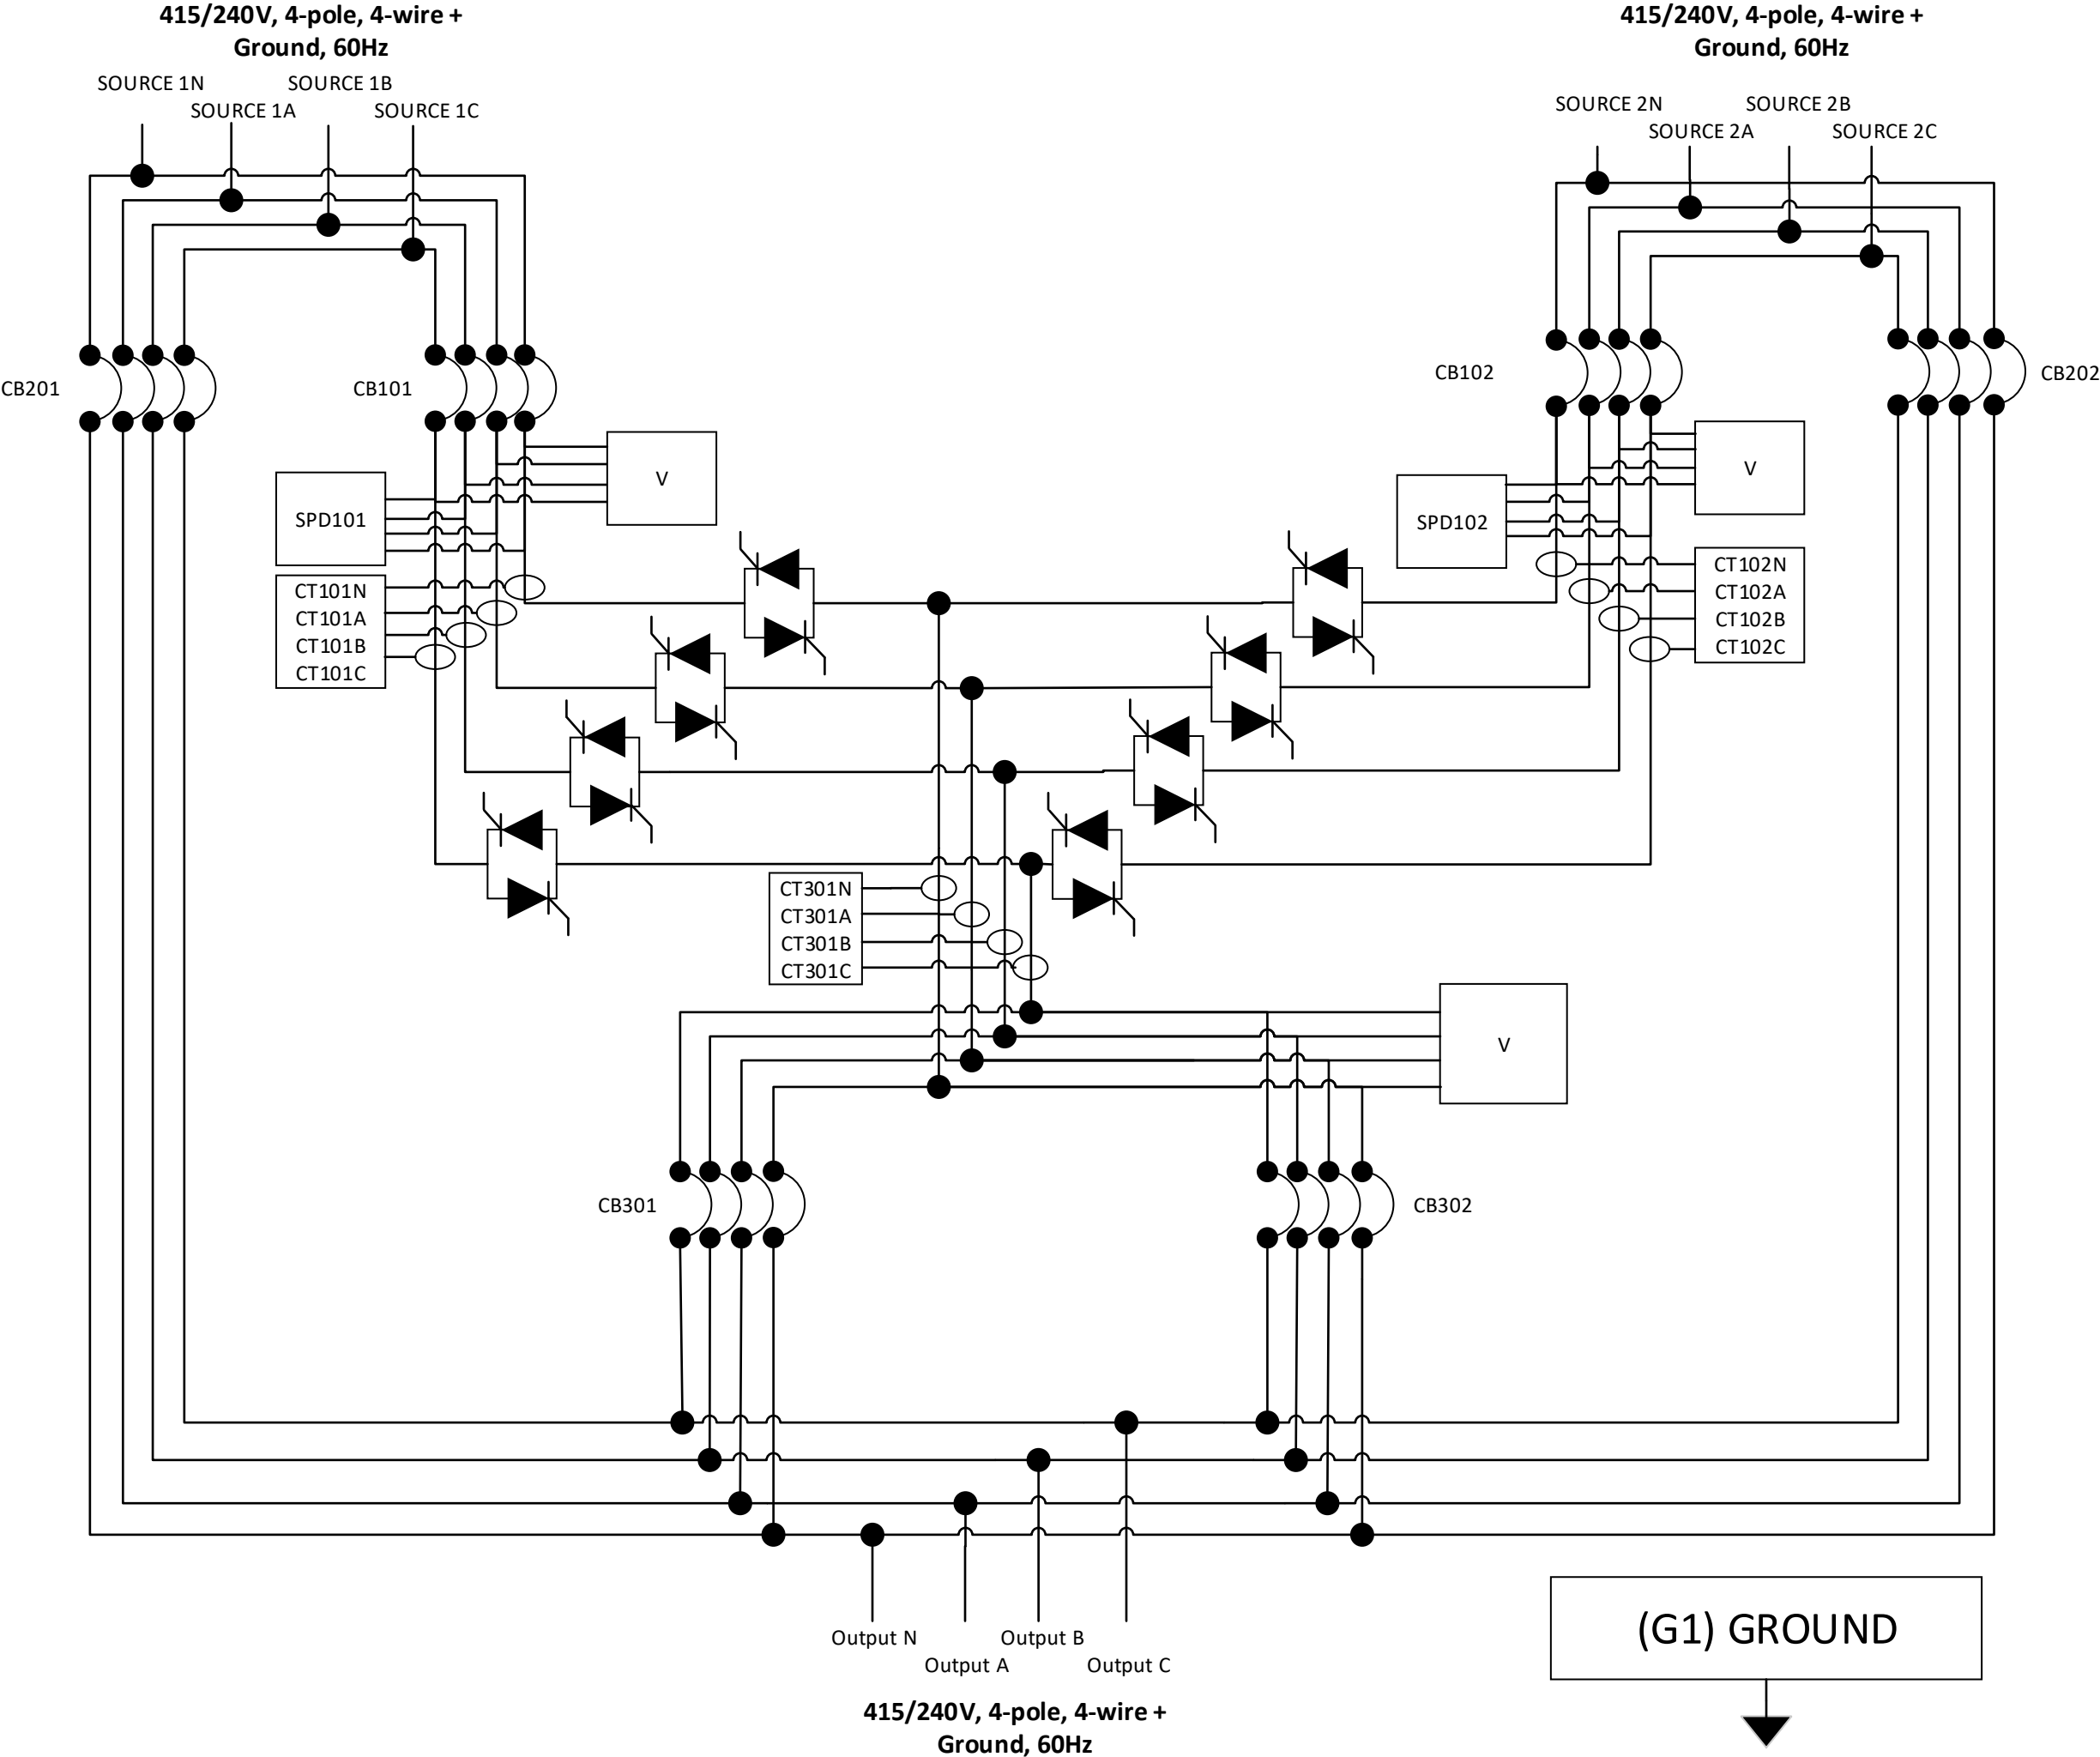

Notes:

1. For alarm/control contacts designations see Customer Interface Board Drawing
2. Control Power Supplies (Qty.18) Derived from Source 1, Source 2, & Output
3. (J1) Ethernet Connection is for Modbus, BACnet, Web
4. SPD for protection of STS components only
5. Each CB (MCS) has Aux Contacts to Monitor position/trip

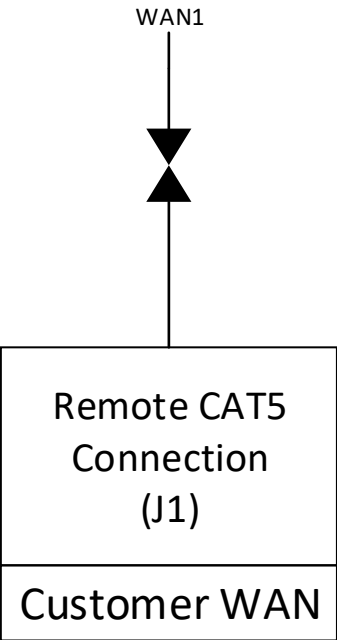

		POWER CIRCUIT SCHEMATIC	
		eSTS, 4 Pole, 4 Wire, SMR/TMR	
DRAWN: ACO	DATE 4/4/24	DWG NO 94-ES-11354-3	REV A
CHK:	DATE		
APPR:	DATE	SHEET 1 OF 1	